




SINGLE VALVE COLLAR

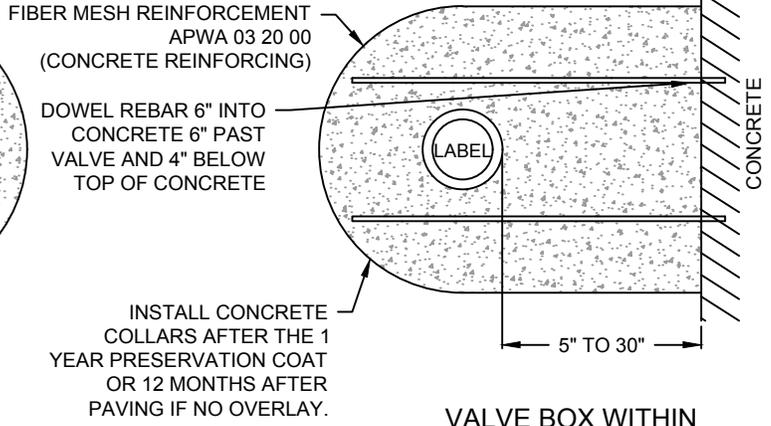

VALVE BOX WITHIN 30" OF CONCRETE

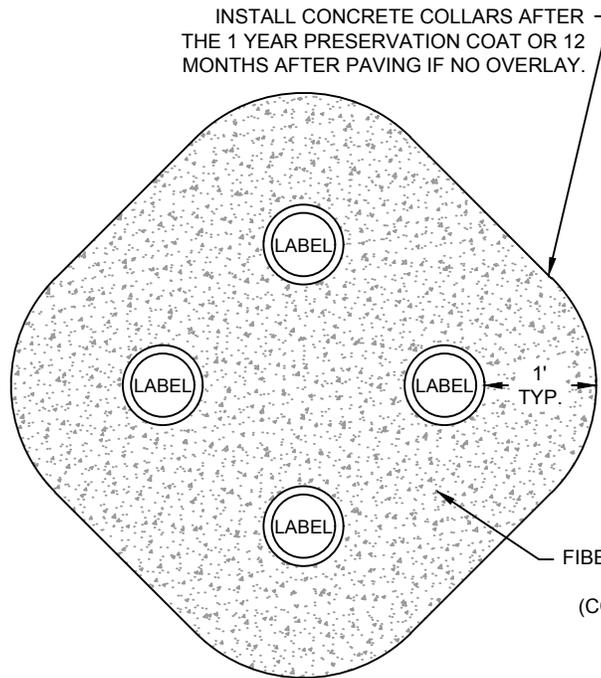


FOUR VALVE COLLAR

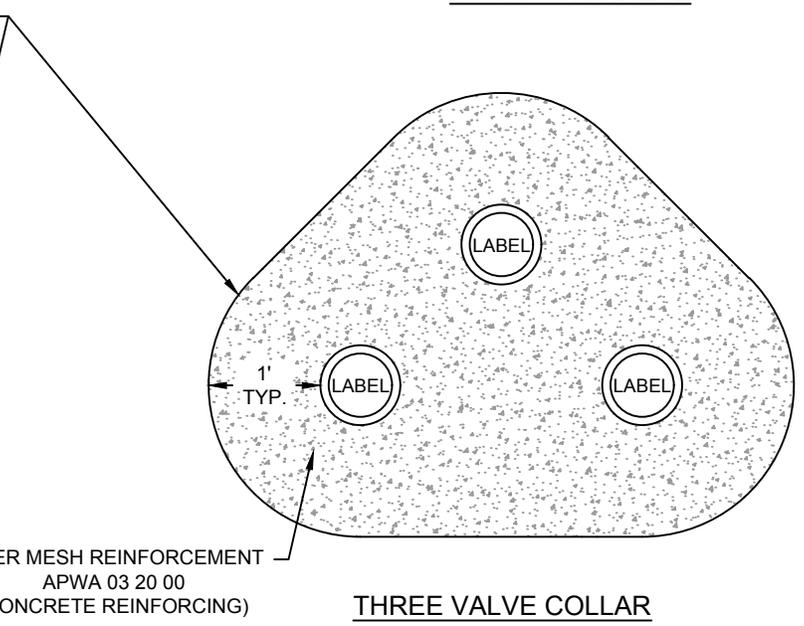

THREE VALVE COLLAR

INSTALL CONCRETE COLLARS AFTER THE 1 YEAR PRESERVATION COAT OR 12 MONTHS AFTER PAVING IF NO OVERLAY.

FIBER MESH REINFORCEMENT APWA 03 20 00 (CONCRETE REINFORCING)

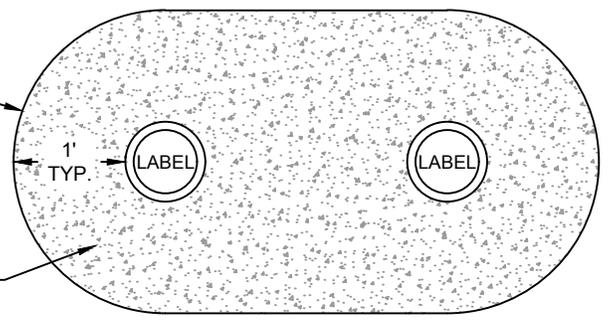

TWO VALVE COLLAR

NOTES:

1. VALVE RINGS AND CONCRETE COLLARS SHALL BE PROTECTED BY A COVERING DURING A SEAL COAT.
2. LABEL ON LID SHALL READ "WATER" FOR DRINKING WATER MAIN VALVES, "FIRE" FOR FIRE LINE VALVES, "IRRIGATION" FOR PRESSURIZED IRRIGATION MAIN VALVES AND "DRAIN" FOR PRESSURIZED IRRIGATION DRAIN VALVES.
3. VALVE BOXES SHALL BE 2 PIECE, CAST IRON, SCREW ADJUSTABLE SLEEVE, 5 1/4" SHAFT WITH A DROP LID.
4. VALVE BOXES ON MAINS TOO SHALLOW FOR 2 PIECE BOXES SHALL HAVE A 10" SLIPTOP, D&L M-8056 OR APPROVED EQUIVALENT. THIS SHALL BE USED FOR PRESSURIZED IRRIGATION MAINS WITH 2' TO 4' OF COVER. VALVE BOX RISERS SHALL BE USED TO BRING TO FINAL GRADE.
5. PRESSURE ZONE AND FIRE HYDRANT VALVES SHALL HAVE A TRIANGLE VALVE BOX LID.



SPANISH FORK CITY
 40 SOUTH MAIN STREET
 SPANISH FORK, UT 84660
 (801) 804-4550

STANDARD DRAWING

VALVE COLLARS

DRAWN:	JLR
DESIGN:	CJP
CHECK:	CMT
DATE:	6/22/16

SCALE:	NONE
STANDARD	12