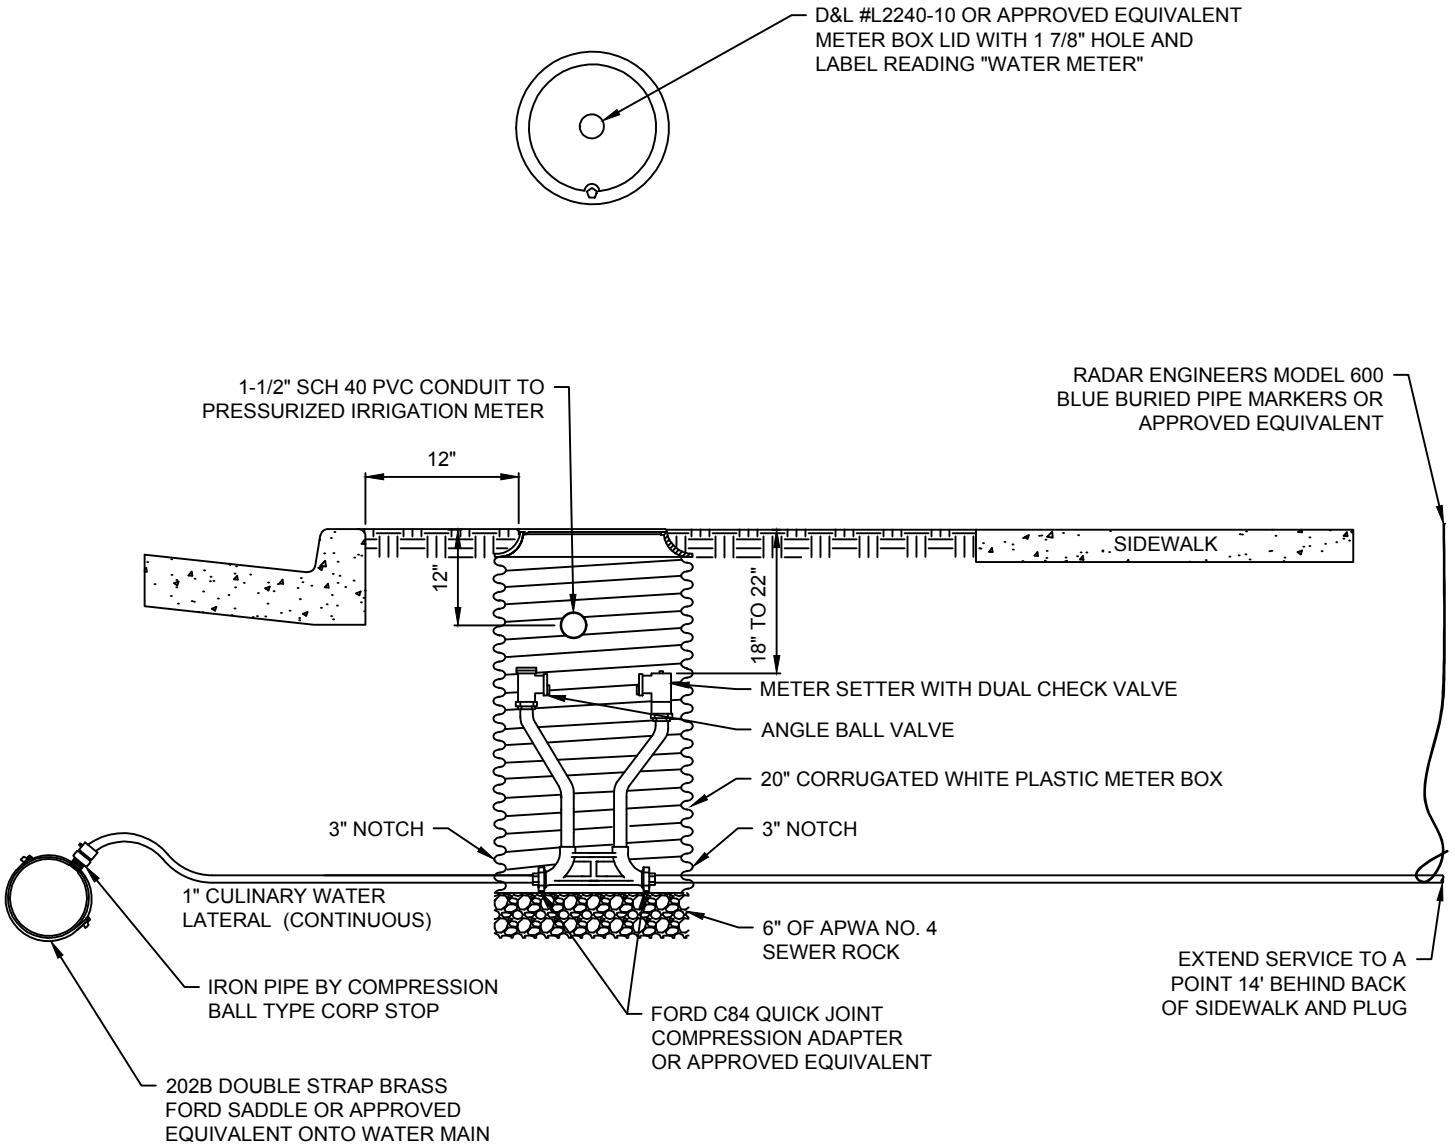

NOTES:

1. CULINARY WATER LATERAL SHALL BE 1" CONTINUOUS TYPE K COPPER OR SDR-9 CTS 200 PSI BLUE POLYPROPYLENE PIPE.
2. STAINLESS STEEL LINER INSERTS SHALL BE REQUIRED INSIDE POLYPROPYLENE PIPE AT COMPRESSION FITTINGS.
3. ALL FITTINGS SHALL BE COMPATIBLE WITH SERVICE SIZE.
4. FOR PLANTER STRIPS LESS THAN 6' WIDE PLACE METER BOX IN CENTER OF PLANTER. WHERE THERE IS NO PLANTER, PLACE CENTER OF METER BOX 20" BEHIND SIDEWALK.
5. EXTEND 18 GAUGE WIRE 3' INTO METER BOX AND TAPE ENDS. BURY CONDUIT 12" BELOW GRADE.
6. WATER METERS LOCATED WITHIN THE DRIVEWAY SHALL HAVE A 48" PRECAST MANHOLE SECTION WITH D&L 1180 OR APPROVED EQUIVALENT MANHOLE FRAME AND LID THAT READS "WATER"

SPANISH FORK CITY
40 SOUTH MAIN STREET
SPANISH FORK, UT 84660
(801) 804-4550

STANDARD DRAWING

1" WATER SERVICE

DRAWN:	JLR
DESIGN:	CJP
CHECK:	CMT
DATE:	6/22/16

SCALE: NONE

STANDARD 15