


A D&L 1180 OR EQUIVALENT MANHOLE FRAME AND LID RECESSED 1/4" BELOW FINISHED GRADE, LID MUST BE LABELED IRRIGATION WITH 1 7/8" HOLE THAT ALLOWS FOR THE INSTALLATION OF A TR PL PAD TOUCH READ DEVICE

STEEL REINFORCED PLASTIC MANHOLE STEPS @ 12" O.C. IN LINE WITH OPENING

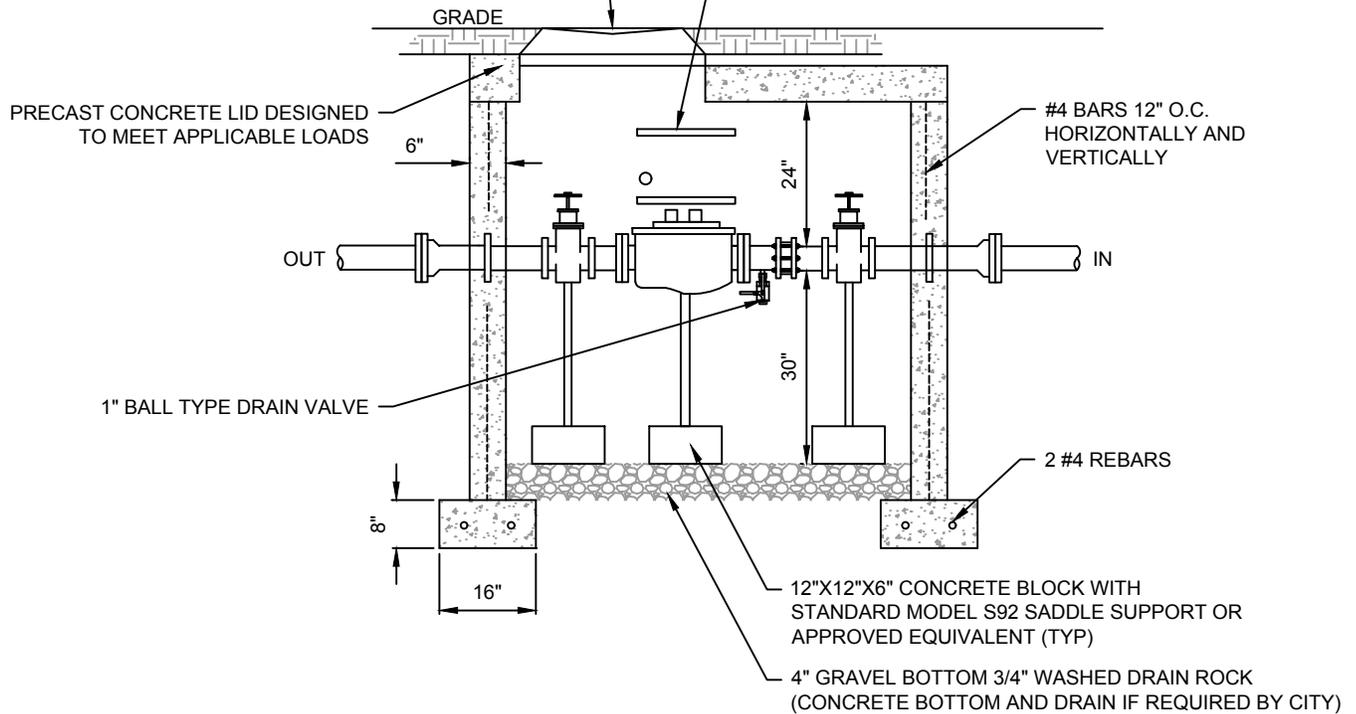

**NOTES:**

1. ALL 4" PIPE AND FITTINGS SHALL BE DUCTILE IRON.
2. ALL 1" PIPE AND FITTINGS SHALL BE BRASS OR COPPER WITH STAINLESS STEEL HANDLE.
3. ALL REBAR SHALL HAVE 30" OVERLAPS.
4. PORTLAND CEMENT CONCRETE MAY ONLY BE POURED ON UNDISTURBED SOIL, 3/4" CRUSHED GRAVEL, OR COMPACTED UNTREATED BASE COURSE.
5. METER BOXES SHALL BE PLACED IN LANDSCAPE AREAS.



**SPANISH FORK CITY**  
 40 SOUTH MAIN STREET  
 SPANISH FORK, UT 84660  
 (801) 804-4550

**STANDARD DRAWING**

4" PRESSURIZED IRRIGATION SERVICE

DRAWN: JLR  
 DESIGN: CJP  
 CHECK: CMT  
 DATE: 6/22/16

SCALE:  
 NONE  
 STANDARD  
 21