


LID DIMENSIONS



NOTES:

1. ALL STORM TRANSMISSION LINES SHALL RUN THROUGH STORM MANHOLES.
2. BOX SHALL BE SIZED ACCORDING TO TABLE ON STANDARD #32.
3. UNLESS OTHERWISE DESIGNED BY A LICENSED PROFESSIONAL ENGINEER, #4 REBAR WILL BE SPACED AT MINIMUM OF 12" O.C. IN ALL DIRECTIONS IN CONCRETE, ALL REBAR SHALL OVERLAP A MINIMUM OF 14".

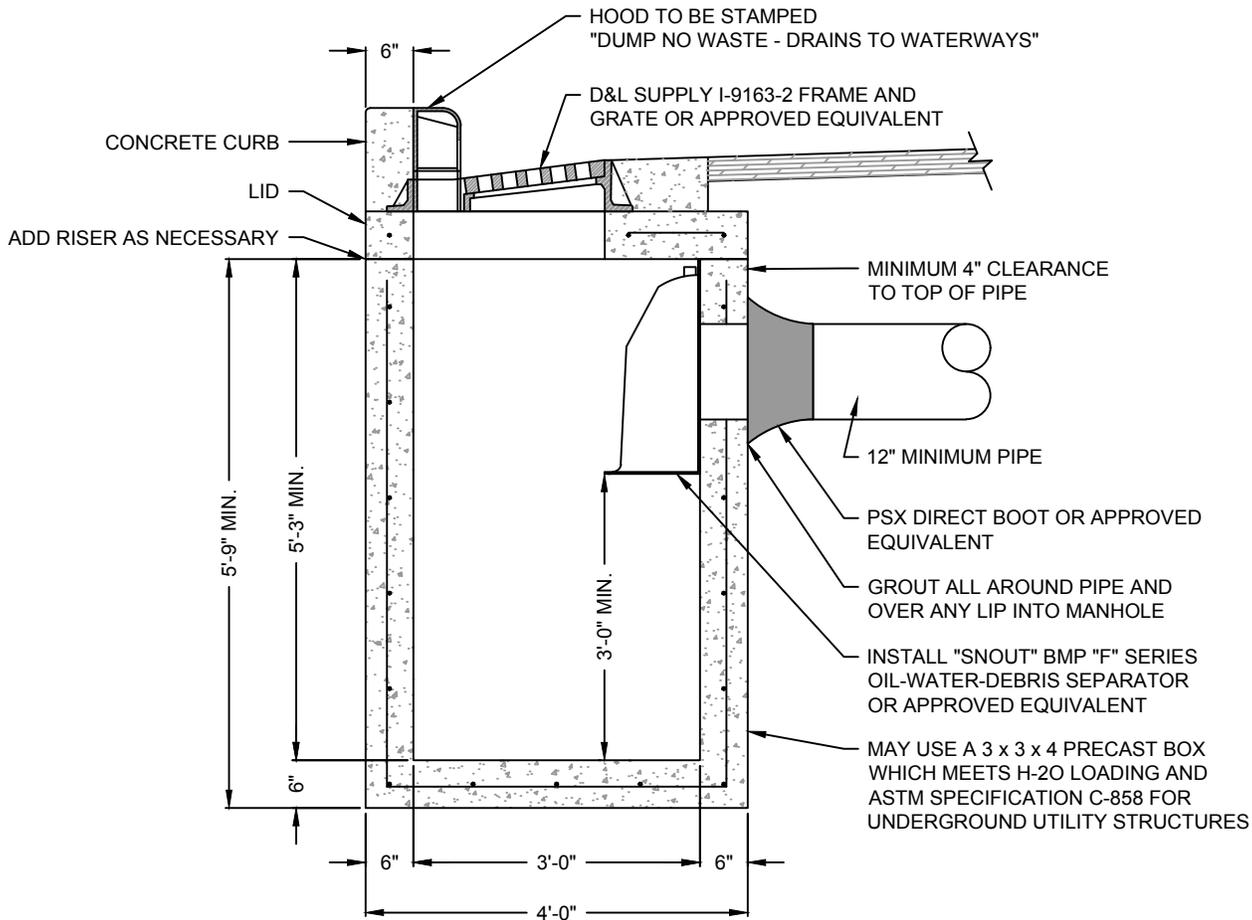

SPANISH FORK CITY
 40 SOUTH MAIN STREET
 SPANISH FORK, UT 84660
 (801) 804-4550

STANDARD DRAWING

STORM WATER INLET BOX

DRAWN: JLR
 DESIGN: CJP
 CHECK: CMT
 DATE: 6/22/16

SCALE: NONE
 STANDARD 27