


STREET LIGHT BASE DETAIL



NOTES:

1. STREET LIGHT BASES SHALL BE INSPECTED PRIOR TO POURING CONCRETE.
2. STREET LIGHT BASES SHALL BE 2' IN DIAMETER AND 6' IN DEPTH WITH 10" OF BASE EXPOSED ABOVE TOP BACK OF CURB.
3. EXPOSED CONCRETE SHALL HAVE A RUBBED FINISH, WITH ALL HONEYCOMB OR CRACKS FILLED.
4. STREET LIGHT BASE SHALL BE CENTERED IN PLANTER STRIP OR 3' FROM TOP BACK OF CURB TO CENTER OF BASE IF NO PLANTER STRIP IS PRESENT.
5. SONNETUBE SHALL BE KEPT DRY AND SHALL NOT BE ALLOWED TO DEFORM IN ANY WAY.
6. CONCRETE COVER OVER REINFORCING STEEL SHALL BE 2" UNLESS OTHERWISE APPROVED.
7. USE 4-#4 REBAR UPRIGHTS & 4-#4 REBAR RINGS SPACED EVENLY AND KEPT 2" FROM SIDES, TOP AND BOTTOM OF CONCRETE.
8. GROUT GAP IN BETWEEN STREET LIGHT AND BASE & PROVIDE 1/2" DRAIN PIPE FOR WATER.
9. ALL STREET LIGHT BASES ALONG STATE ROADS ARE TO BE FLUSH WITH THE TBC AND CONNECTED TO THE LIGHT POLE WITH A BREAKAWAY SUPPORT.

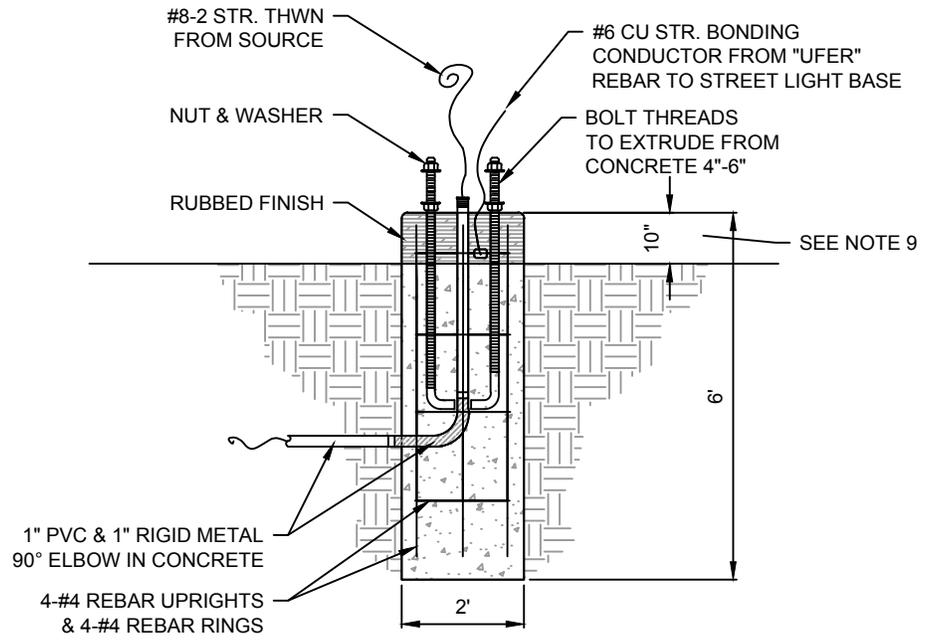

SPANISH FORK CITY
 40 SOUTH MAIN STREET
 SPANISH FORK, UT 84660
 (801) 804-4550

STANDARD DRAWING

STREET LIGHT POLE BASE DETAIL

DRAWN:	JLR
DESIGN:	CJP
CHECK:	CMT
DATE:	6/22/16

SCALE:	NONE
STANDARD	75