



PLAN VIEW

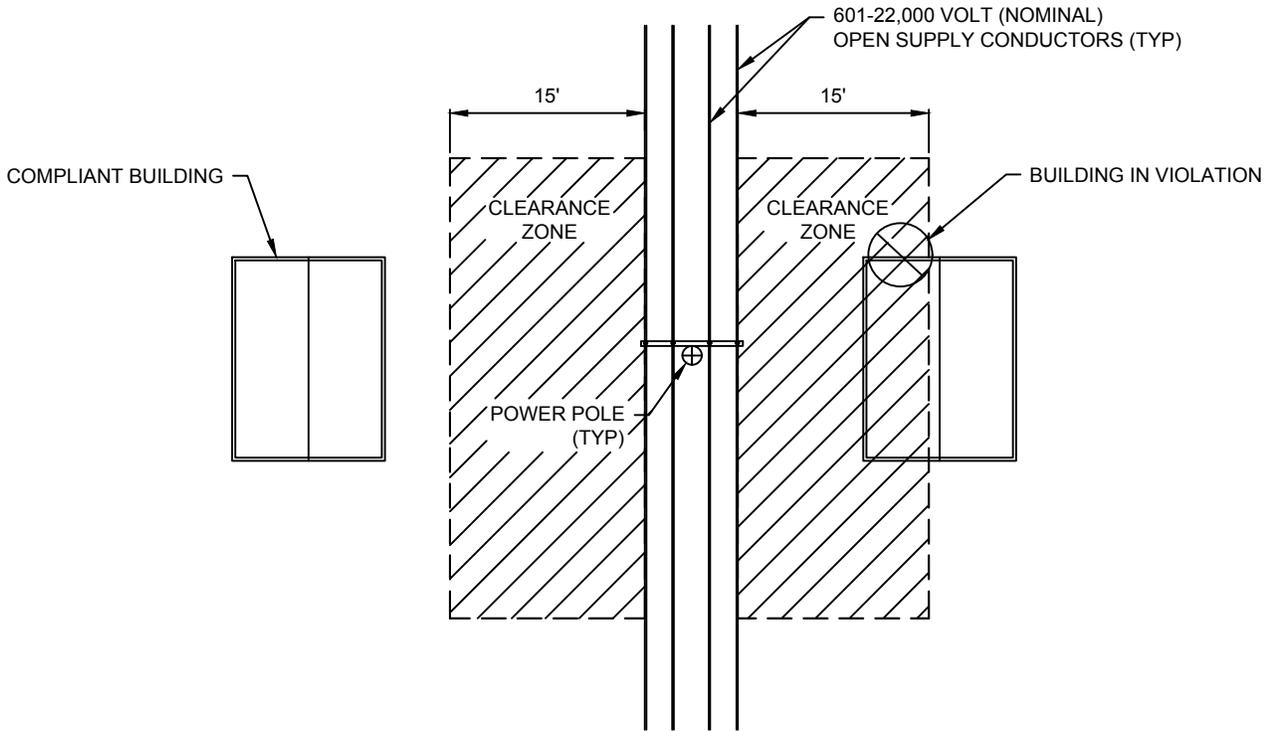

ELEVATION VIEW

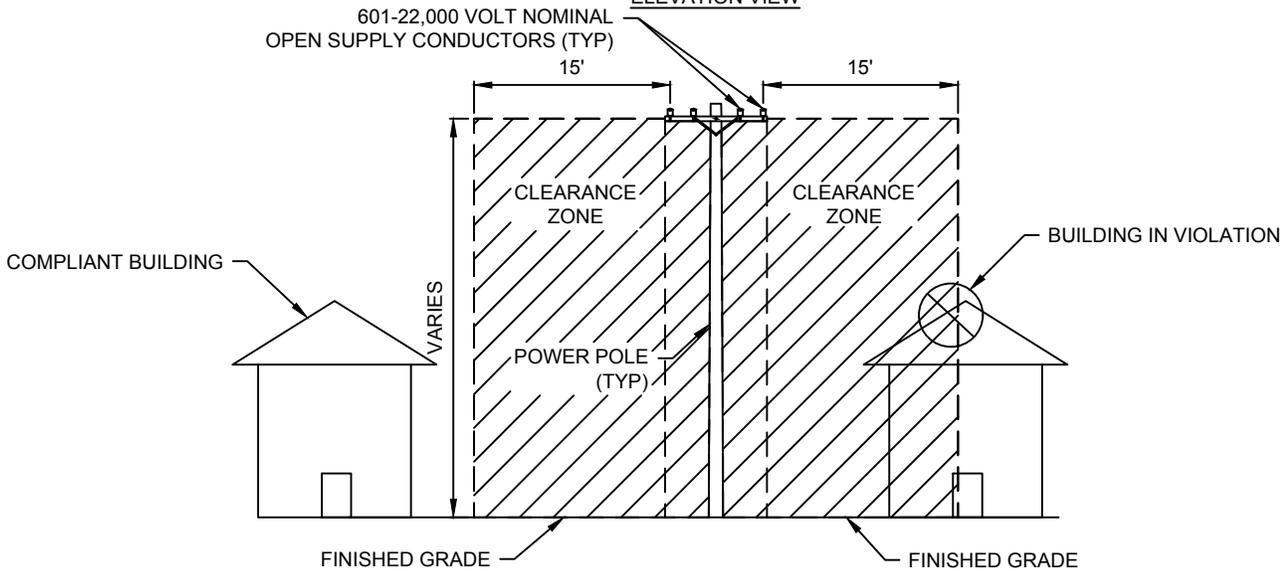

**NOTES:**

1. NO BUILDING OR STRUCTURE SHALL BE PLACED, OR CONSTRUCTED IN THE POWER LINE CLEARANCE ZONE.
2. CLEARANCES GIVEN ARE TYPICAL AND APPLY TO OPEN SUPPLY PRIMARY CIRCUITS OPERATING AT OVER 600 VOLTS UP TO 22,000 VOLTS, AND MAY NOT APPLY TO ALL CASES OR CIRCUMSTANCES.
3. CLEARANCES DO NOT APPLY TO SECONDARY INSULATED SERVICE CIRCUITS OPERATING AT 600 VOLTS OR LESS.
4. TYPICAL CLEARANCES INCLUDE THE COMPLETE VERTICAL & HORIZONTAL SPACE AROUND POWERLINES FROM THE OUTSIDE CONDUCTOR TO ANY BUILDING, SIGN, OR STRUCTURE.
5. TYPICAL CLEARANCES FOR 12KV PRIMARY OVERHEAD DISTRIBUTION CIRCUITS ARE 15' FROM THE OUTSIDE CONDUCTOR IN ANY DIRECTION FROM ANY BUILDING, SIGN, OR STRUCTURE
6. TYPICAL CLEARANCES FOR 46KV PRIMARY OVERHEAD TRANSMISSION CIRCUITS ARE 30' FROM THE OUTSIDE CONDUCTOR IN ANY DIRECTION FROM ANY BUILDING, SIGN, OR STRUCTURE.
7. SPECIAL APPLICATIONS, HIGHER VOLTAGES, RAILROAD TRACKS, SWIMMING POOLS, AND OPEN WATER MAY RESULT IN ADDITIONAL CLEARANCES AND SHALL BE APPROVED BY ELECTRIC DEPARTMENT.



**SPANISH FORK CITY**  
 40 SOUTH MAIN STREET  
 SPANISH FORK, UT 84660  
 (801) 804-4550

**STANDARD DRAWING**

OVERHEAD POWERLINE CLEARANCES OVER 600 VOLTS TO 22,000 VOLTS

DRAWN: JLR  
 DESIGN: CJP  
 CHECK: CMT  
 DATE: 6/22/16

SCALE:  
 NONE  
**STANDARD**  
 83